SUBMITTAL DATA SHEET

Series Name: Floor Ceiling Single Zone
Model Number: FC24H525ZMI/SZ24H525ZMO



| | Ceiling&Floor Heat Pump System | |
|---------------|--------------------------------|--|
| Location: | Approval: | |
| Engineer: | Date: | |
| Submitted to: | Construction: | |
| Submitted by: | Unit #: | |
| Reference: | Drawing #: | |



| | EFFIC | IENCY | |
|---------|-------|---------|------|
| Cooling | | Heating | |
| SEER2 | 21.1 | HSPF2-4 | 11.1 |
| EER2 | 12.2 | СОР | 2.99 |

| | PERFORMAN | CE of Cooling |
|-------------------|-----------------|--------------------------|
| | Cooling | (Btu/hr) |
| Rated Capacity | | 24000 |
| Min/Max Capacity | | 11100~29000 |
| Moisture Removal | (L/h) | 3.07 |
| Standard Operatir | ng Range(°F/°C) | -13~122(-25 ~ 50) |
| Conditions: | | Indoor: 80°F DB/67°F WB |
| | | Outdoor: 95°F DB/75°F WB |

| PERFORMAN | ICE of Heating |
|---------------------------------|--------------------------|
| Heating | g (Btu/hr) |
| 1. @ 47°F Rated | 24500 |
| 1. @ 47°F Min/Max Capacity | 11800~32600 |
| 2. @ 17°F Rated | 20000 |
| 3. @ 5°F Rated: Capacity / COP | 18600/2.27 |
| 3. @ 5°F Max: Capacity | 18600 |
| Standard Operating Range(°F/°C) | -13~75(-25~24) |
| 1. Conditions: | Indoor: 70°F DB/60°F WB |
| | Outdoor: 47°F DB/43°F WB |
| 2. Conditions: | Indoor: 70°F DB/60°F WB |
| | Outdoor: 17°F DB/15°F WB |
| 3. Conditions | Indoor: 70°F DB/60°F WB |
| | Outdoor: 5°F DB/5°F WB |


| INDOOR SPEIN | NDOOR SPECIFICATI | ONCIFICATION |
|-----------------------------|-------------------|---------------------------------------|
| Indoor Air Flow (Turbo/H/M | /L/Si) (CFM) | 735.8 / 706.3 / 606.3 / 453.2 / 376.7 |
| Indoor Noise Level (Turbo/H | /M/L/Si) (dBA) | 51.0/49.0/45.0/34.0/29.0 |
| Dimension (W×D×H) | inch | 42.05 x 26.57 x 9.25 |
| Package (W×D×H) | inch | 45.08 x 29.72 x 12.52 |
| Net/Gross Weight | lbs | 61.29/73.19 |


| OU | ITDOOR SPECIFICAT | ION |
|-----------------------|-------------------|-----------------------|
| Compressor Typ | De | ROTARY |
| Compressor Mod | lel | KTM240D46UKT2 |
| Refrigerant | | R454B |
| Refrigerant Oil Charg | ge(mL) | 620 |
| Refrigerant Oil | | VG74 |
| Outdoor Air Flow (Max | () (CFM) | 2236.7 |
| Outdoor Noise Level | (dBA) | 59.0 |
| Dimension (W×D×H) | inch | 37.24 x 16.14 x 31.89 |
| Package (W×D×H) | inch | 42.91 x 19.68 x 34.84 |
| Net/Gross Weight | lbs | 122.13/132.28 |

| ELECTRICAL | |
|----------------------------------|--|
| Power Supply | 208/230V,60Hz,1Ph |
| System MCA | 24.00 |
| Connection Wiring | 14#x4 |
| System MOCP | 25 |
| Compressor RLA | 15.4 |
| Outdoor Fan Motor RLA | 1.0 |
| Outdoor Fan Motor W | 120 |
| Indoor Fan Motor RLA | 1.0 |
| Indoor Fan Motor W | 96 |
| System Power Input @ Cooling (W) | 1967(820 ~ 2610) |
| System Power Input @ Heating (W) | 2385(675 ~2990) |
| MCA: Min. circuit amps (A) | MOCP: Max. over current protection (A) |
| RLA: Rated load amps (A) | W : Fan motor rated output (W) |


| PIPING | |
|---|--------------------|
| Throttle type(Indoor) | N/A |
| Throttle type(Outdoor) | EXV+Throttle valve |
| Liquid Size | 9.52mm(3/8in) |
| Gas Size | 15.9mm(5/8in) |
| Max. Piping Length(ft/m) | 164.00(50) |
| Max. Height Difference(ft/m) | 82.00(25) |
| Max. Pre-charged Length(ft/m) | 24.6(7.5) |
| Refrigerant Pre-charged Amount(oz/kg) | 70.55(2.00) |
| Additional Charge of Refrigerant((oz/ft)/(g/m)) | 0.32(30) |
| Connection Method | Flared |

- 2 Style Installation
- 3D Airflow
- Refrigerant leakage detection sensor
- Humidity sensor
- ●"88" display tube
- 1~100% fan speed setting
- WiFi capability: through WiFi dongle or wired controller with built-in WiFi
- OTA(by using WiFi dongle)
- 2-pin connector(HA/HB) for programmable wired controller
- Multiple control options available:
 - Two way communication wired controller:120N(X6)
 - O Two way communication wired controller with built-in WiFi:120N(X6W)
 - O Infrared wired controller: 120L
 - O Wireless remote controller
 - O Third-Party 24V Thermostat*

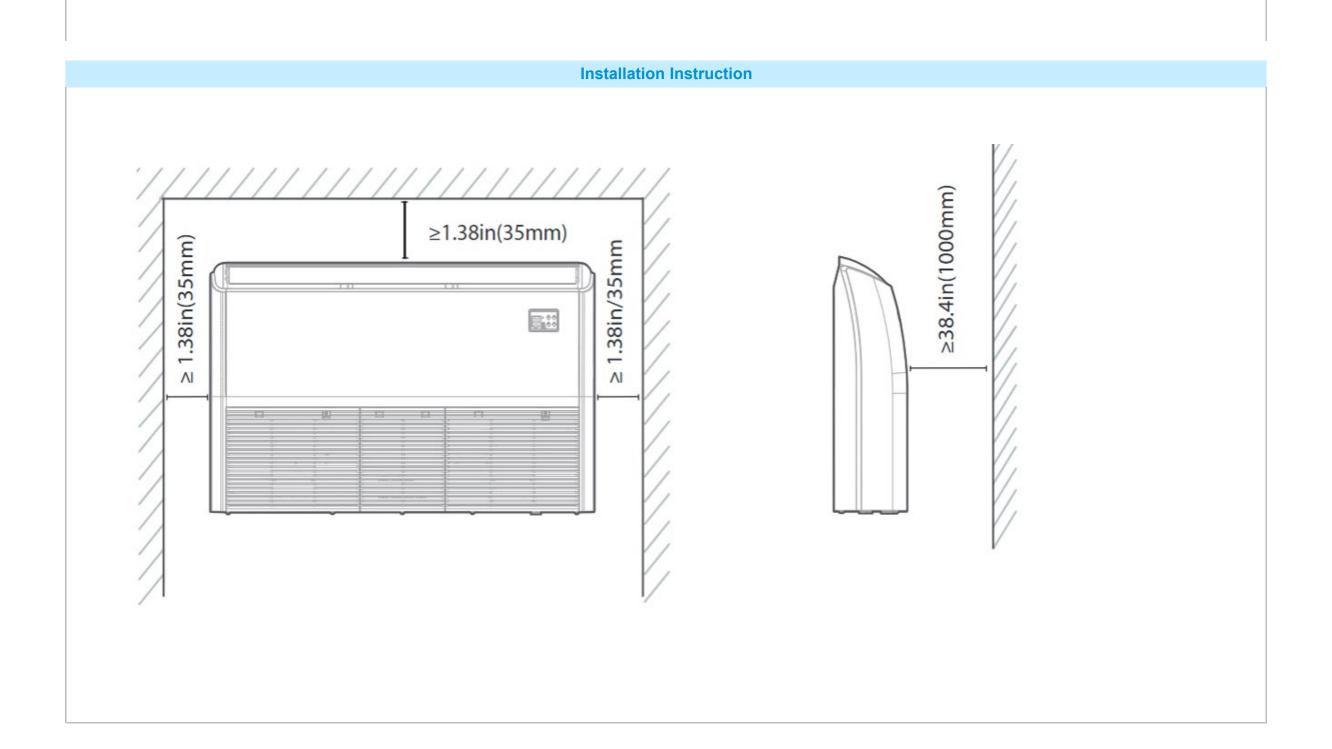

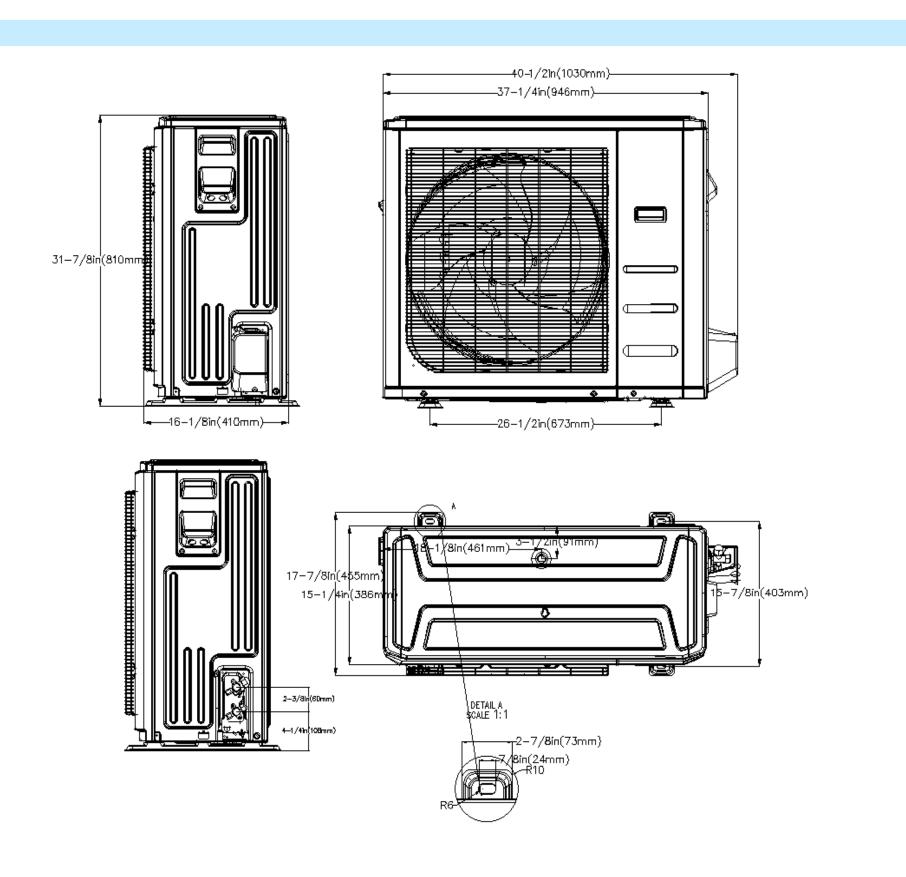

Installation Instruction

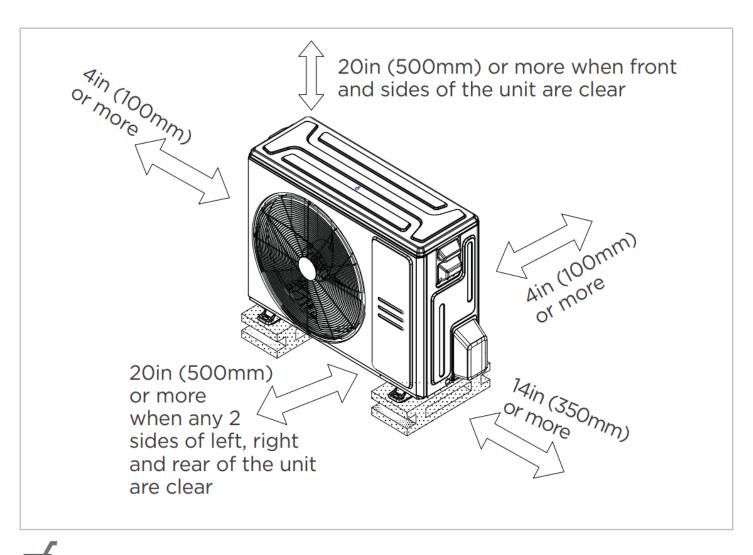

Meets all spatial requirements shown in Installation Clearance Requirements above.